


PIPING SHOWN IN DASHED LINES IS
 TO BE SUPPLIED BY CUSTOMER
 ACTUAL LOCATION & LENGTH MAY VARY

NOTE:
 FLOW METER REQUIRES (15) PIPE DIAMETER
 LENGTHS BEFORE METER & (10) AFTER FOR
 PROPER OPERATION

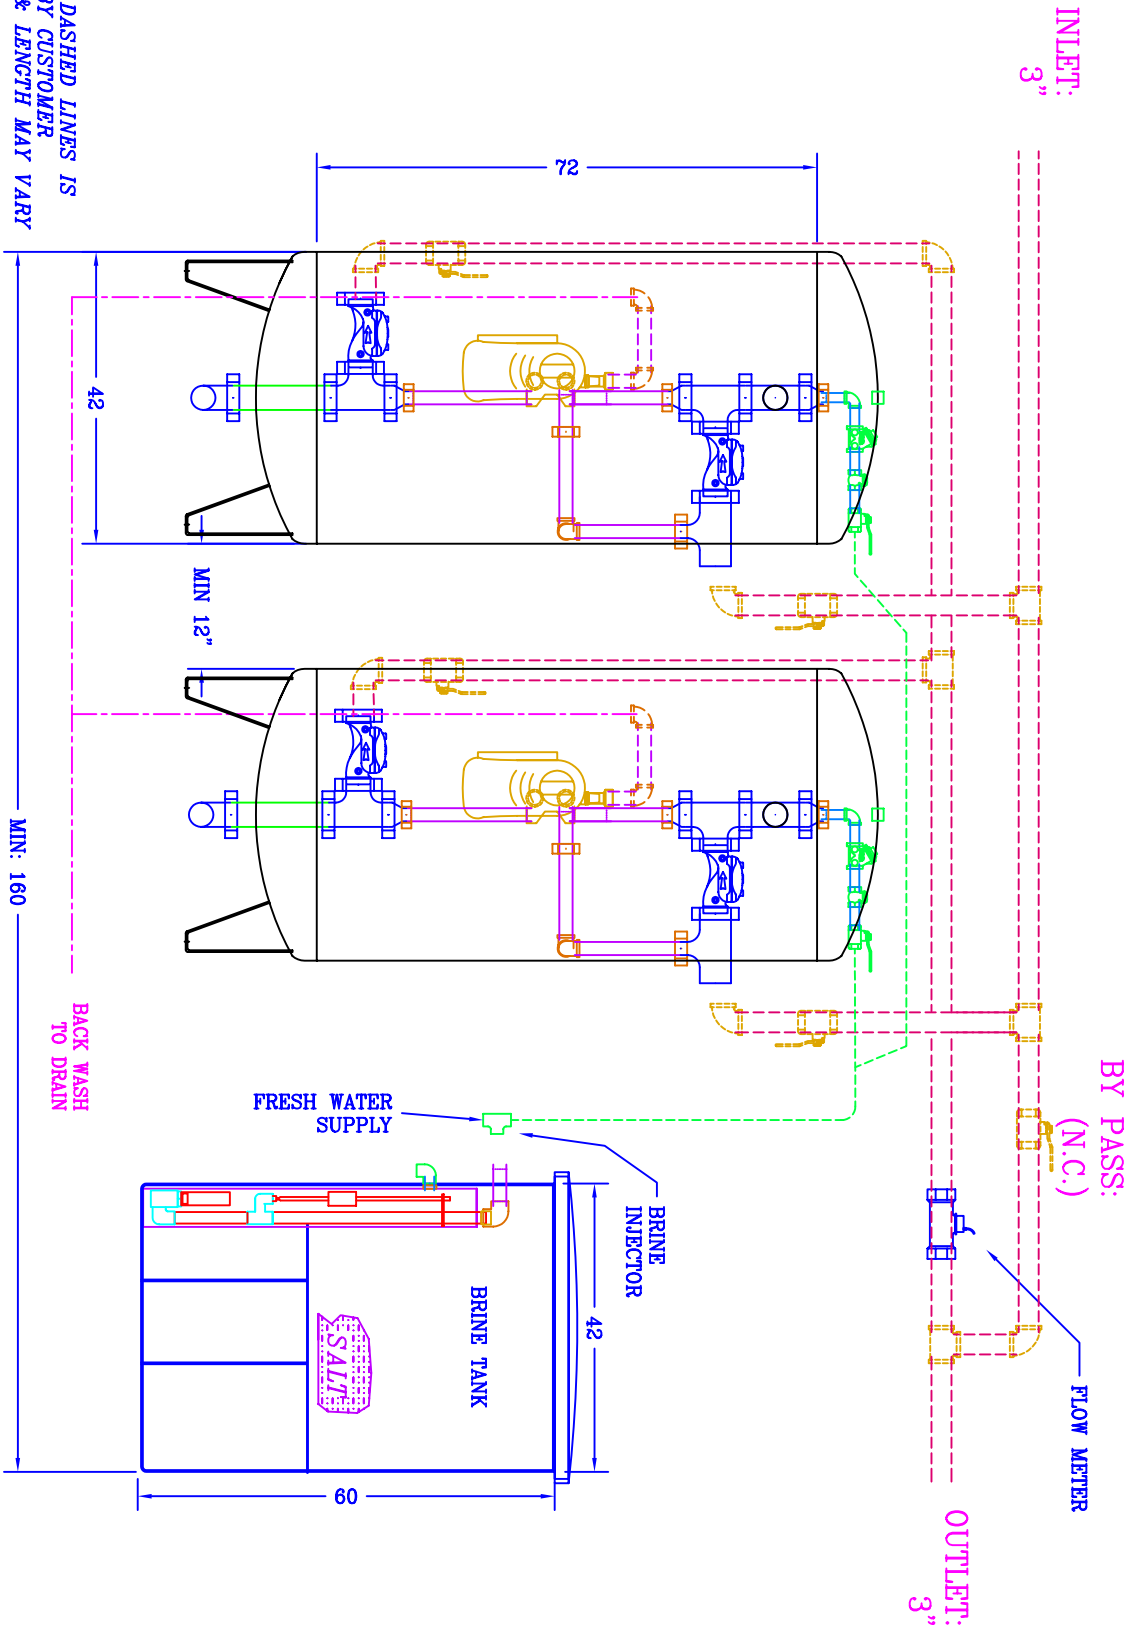

BY: NO.	REVISION	DATE	CHKD
0	ISSUED FOR	10/24/2007	
1			

102 Charbonnet Rd., Duxon, Louisiana, U.S.A. 70529

Water King
 WATER CONDITIONING

920902-11A-3
 MF-900 TWIN ALTERNATING SOFTENER
 TYPICAL PIPING ARRANGEMENT

SCALE @ 24"=36"

N.T.S. DRAWING NUMBER: WKMF-900-S3-TA SHEET: 01 / 01

www.waterking.com