


TOP VIEW

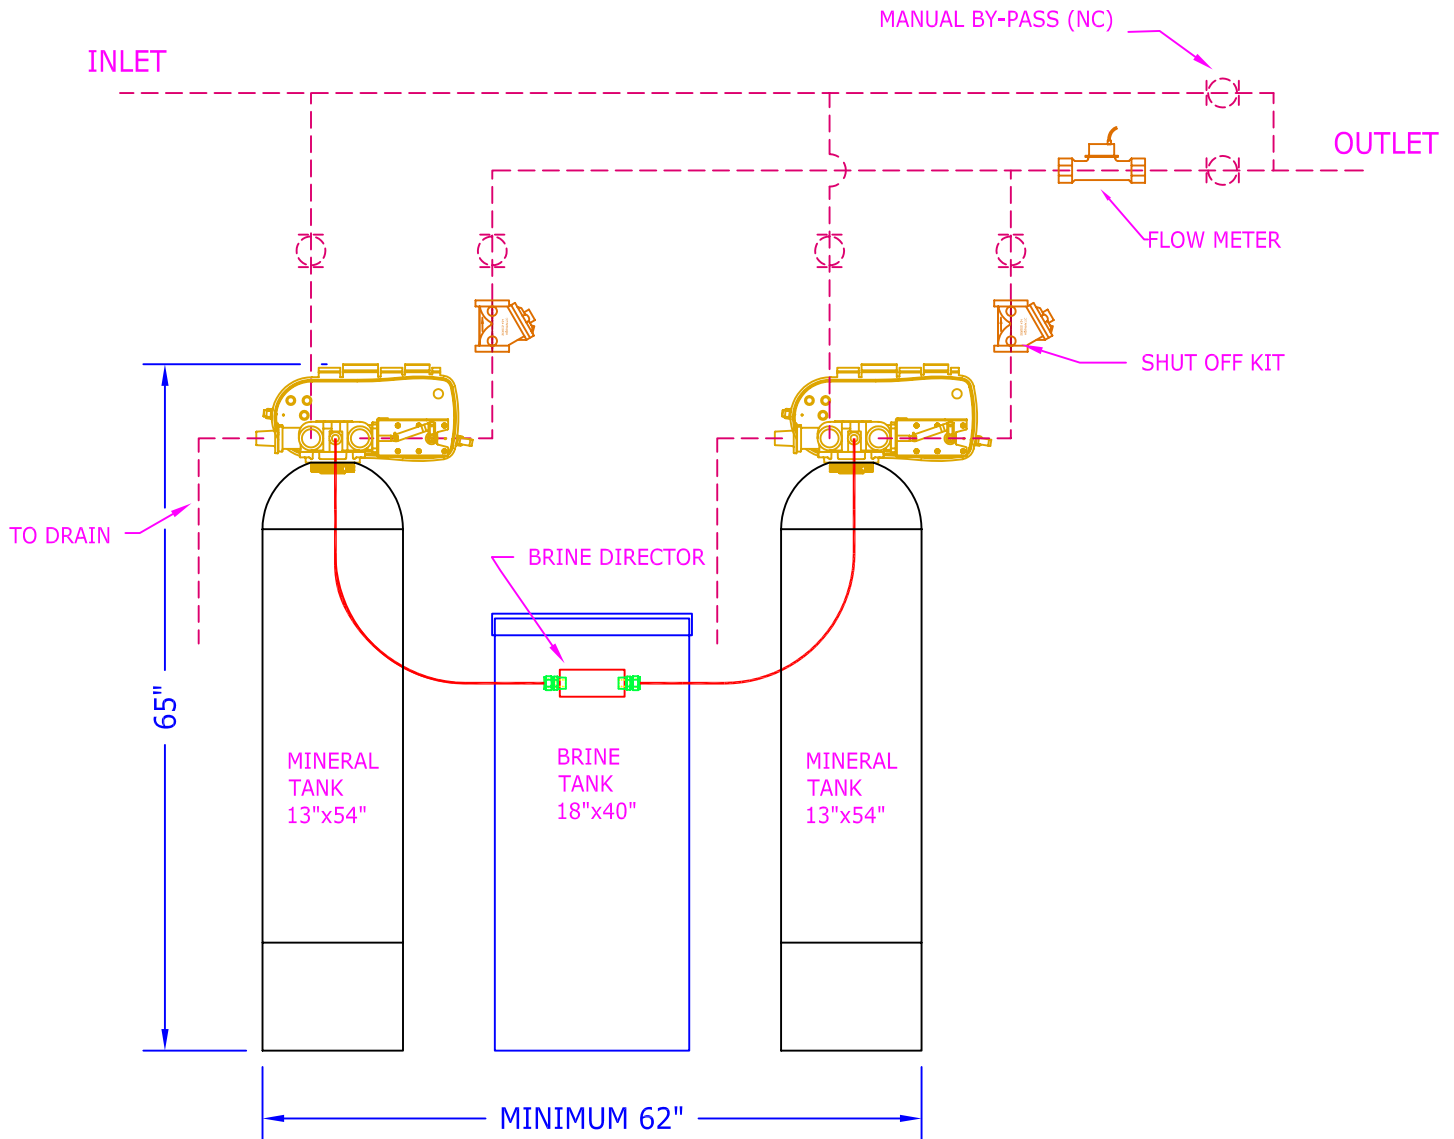

ELEVATION

NOTES:

- 1) PIPING SHOWN IN DASHED LINES TO BE SUPPLIED BY OTHERS.
- 2) ALL DIMENSIONS ±1" AND SUBJECT TO CHANGE WITHOUT NOTICE.
- 3) UNIONS SHOULD BE LOCATED ON INLET AND OUTLET CONNECTIONS OF CONTROL VALVE TO FACILITATE SERVICING.
- 4) USE OF DISSIMILAR METALS IN PIPING SYSTEM IS NOT RECOMMENDED. USE OF DIELECTRIC FITTINGS BETWEEN DISSIMILAR METALS MAY REDUCE GALVANIC CORROSION.
- 4) ALLOW 2 FEET ABOVE TANKS FOR LOADING.
- 5) ELECTRICAL OUTLET SHOULD BE PROVIDED WITHIN 5 FEET OF EQUIPMENT.
- 6) WHEN USING A FLOW METER, PROVIDE (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION. FLOW METER SHOULD BE MOUNTED HORIZONTALLY.
- 7) TO PERMIT OBSERVATION OF FLOE, PROVIDE AIR GAP OF AT LEAST 4 PIPE DIAMETERS BETWEEN DRAIN PIPE AND DRAIN OR CONFORM TO LOCAL CODES.
- 8) FRP TANKS MUST NOT BE SUBJECTED TO VACUUM. INSTALL SIPHON BREAK AT DRAIN LINE, INSTALL VACUUM BREAKER ON INLET PIPING IF SERVICE LINE IS SUBJECT TO A VACUUM.

SHIPPING WEIGHT	565 Lbs.
OPERATING WEIGHT	

BY:	No.	REVISION	DATE	CK'D
RLR	0	SUBMITTAL FOR APPROVAL	03/29/2011	JEB



910072-11 RF-70 TWIN ALTERNATING SOFTENER GENERAL ARRANGEMENT		
SCALE	DRAWING NUMBER	SHEET
N.T.S.	RF-70-1.5-TA	01 / 01
www.waterking.com		