


TOP VIEW

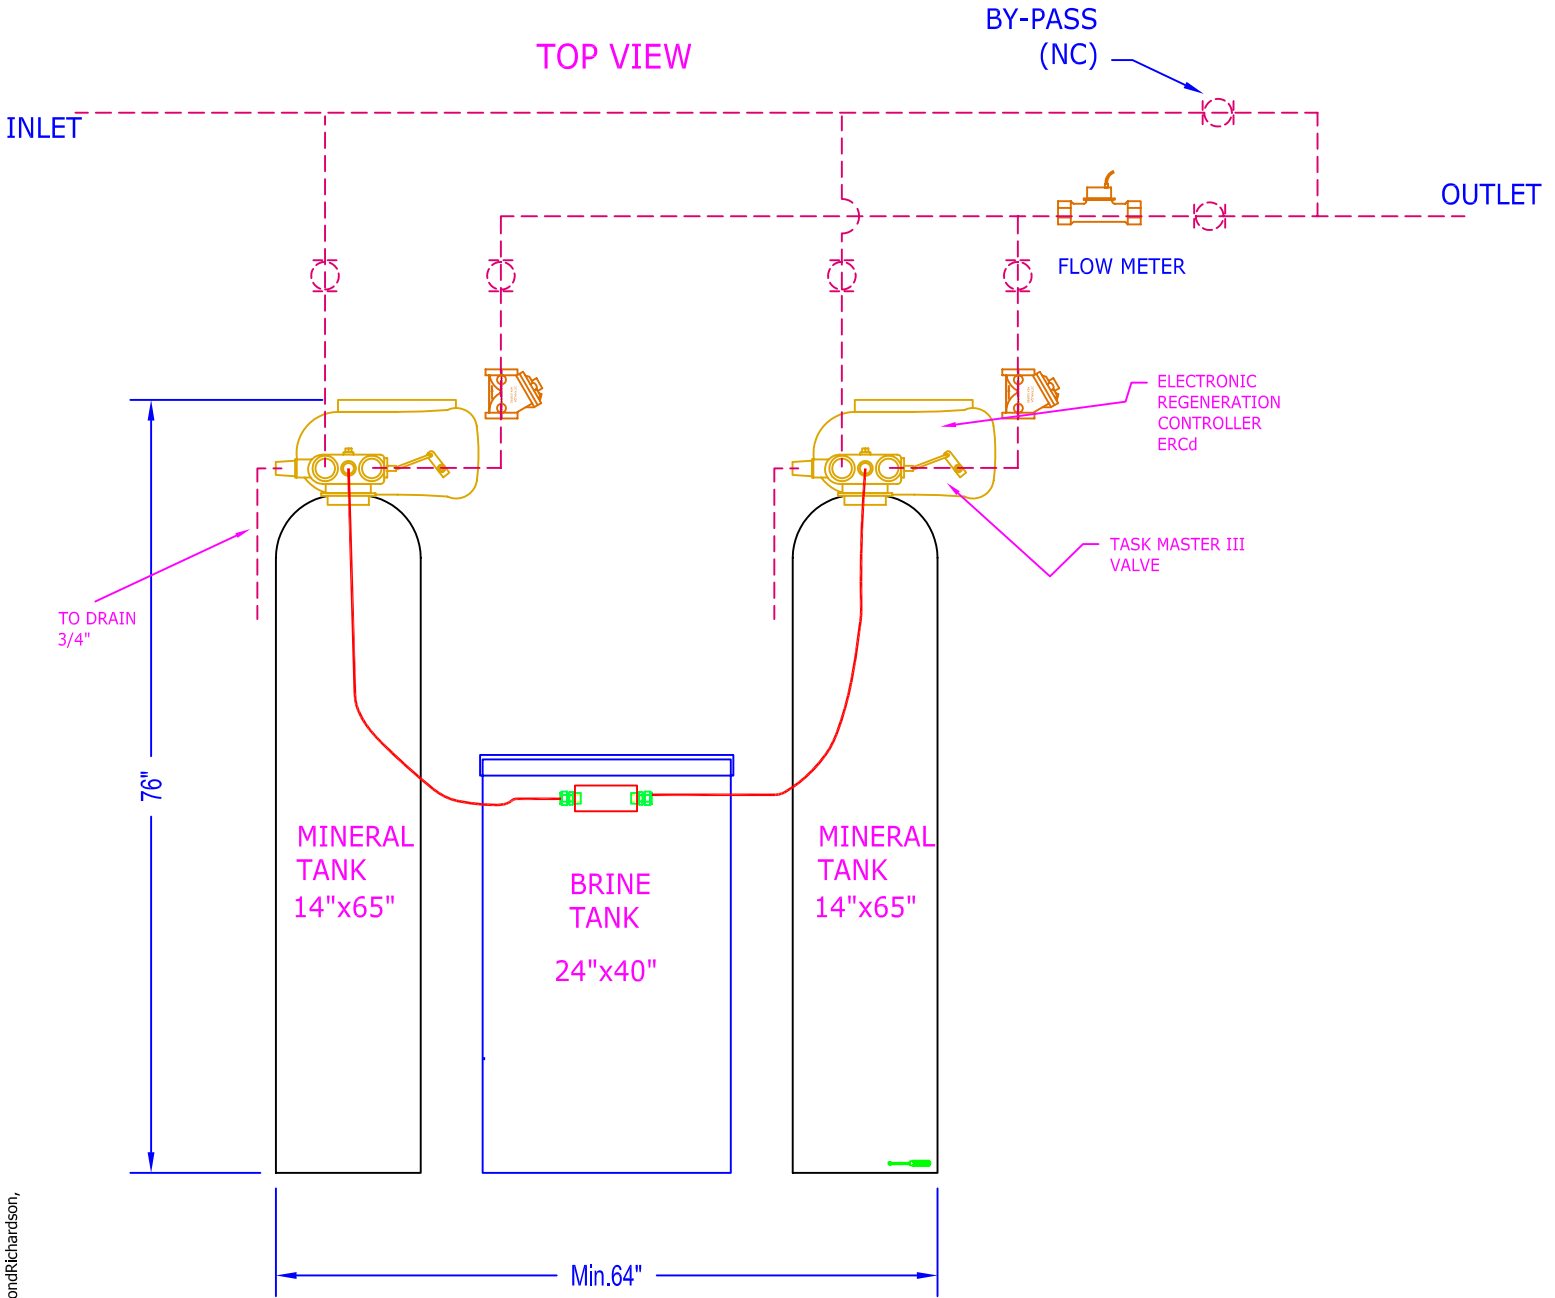

FRONT VIEW

NOTES:

- 1) PIPING SHOWN IN DASHED LINES - SUPPLIED BY CUSTOMER
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING
- 3) FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION
- 4) FLOW METER SHOULD BE MOUNTED HORIZONTALLY

C:\CATALOG\Wkrf100T.dwg, 3/14/2011 3:08:50 PM, RaymondRichardson, Adobe PDF, Letter, 1:18.5722, Water King Inc.

| BY: | No. | REVISION | DATE | ckd |
|--|-----|-----------------------|------------|-----|
| | 0 | PRELIMINARY | 9/30/99 | |
| | 1 | UPDATE BRINE TANK | 1/20/2006 | |
| | 2 | UPDATE CONTROL VALVE | 9/24/2007 | |
| | 3 | UPDATE , ADD TOP VIEW | 03/14/2011 | |
| 102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529 | | | | |

Water King
WATER CONDITIONING

| | | |
|---|----------------|----------|
| 910102-11 RF-100-TA WATER SOFTENER TYPICAL PIPING ARRANGEMENT | | |
| SCALE @ 24"x36" | DRAWING NUMBER | SHEET |
| N.T.S. | WKRF100T | 01 / 0 1 |
| www.waterking.com | | |

| | |
|---------------|----------|
| SHIPPING Wt. | 250 lbs. |
| OPERATING Wt. | |