


TOP VIEW

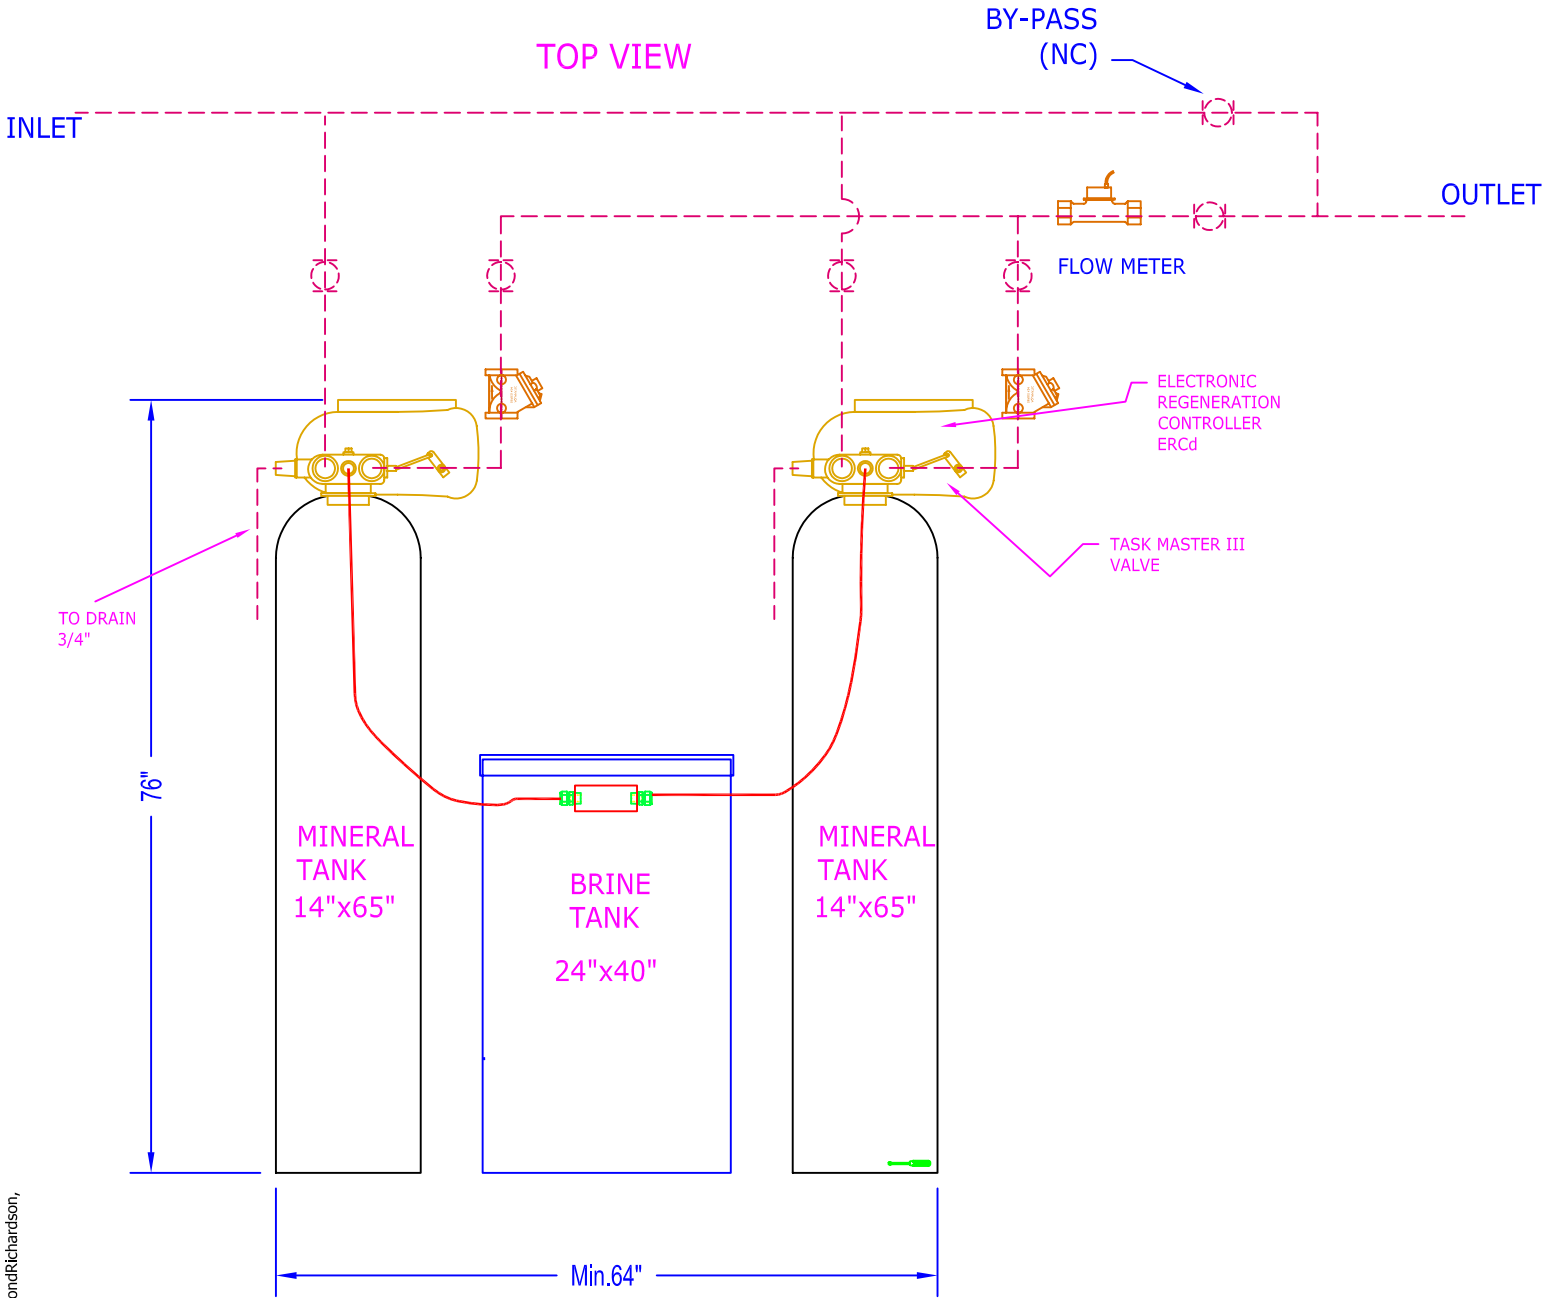

FRONT VIEW

NOTES:

- 1) PIPING SHOWN IN DASHED LINES - SUPPLIED BY CUSTOMER
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING
- 3) FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION
- 4) FLOW METER SHOULD BE MOUNTED HORIZONTALLY

C:\CATALOG\Wkrf100T.dwg, 3/14/2011 3:08:50 PM, RaymondRichardson, Adobe PDF, Letter, 1:118.5722, Water King Inc.

BY:	No.	REVISION	DATE	ckd
-	0	PRELIMINARY	9/30/99	-
	1	UPDATE BRINE TANK	1/20/2006	
	2	UPDATE CONTROL VALVE	9/24/2007	
	3	UPDATE , ADD TOP VIEW	03/14/2011	
102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529				

Water King
WATER CONDITIONING

Telephone: (337) 988-2360 * Fax: (337) 981-7922

910102-11 RF-100-TA WATER SOFTENER TYPICAL PIPING ARRANGEMENT		
SCALE @ 24"x36"	DRAWING NUMBER	SHEET
N.T.S.	WKRF100T	01 / 0 1
www.waterking.com		

SHIPPING Wt.	250 lbs.
OPERATING Wt.	