


TOP VIEW

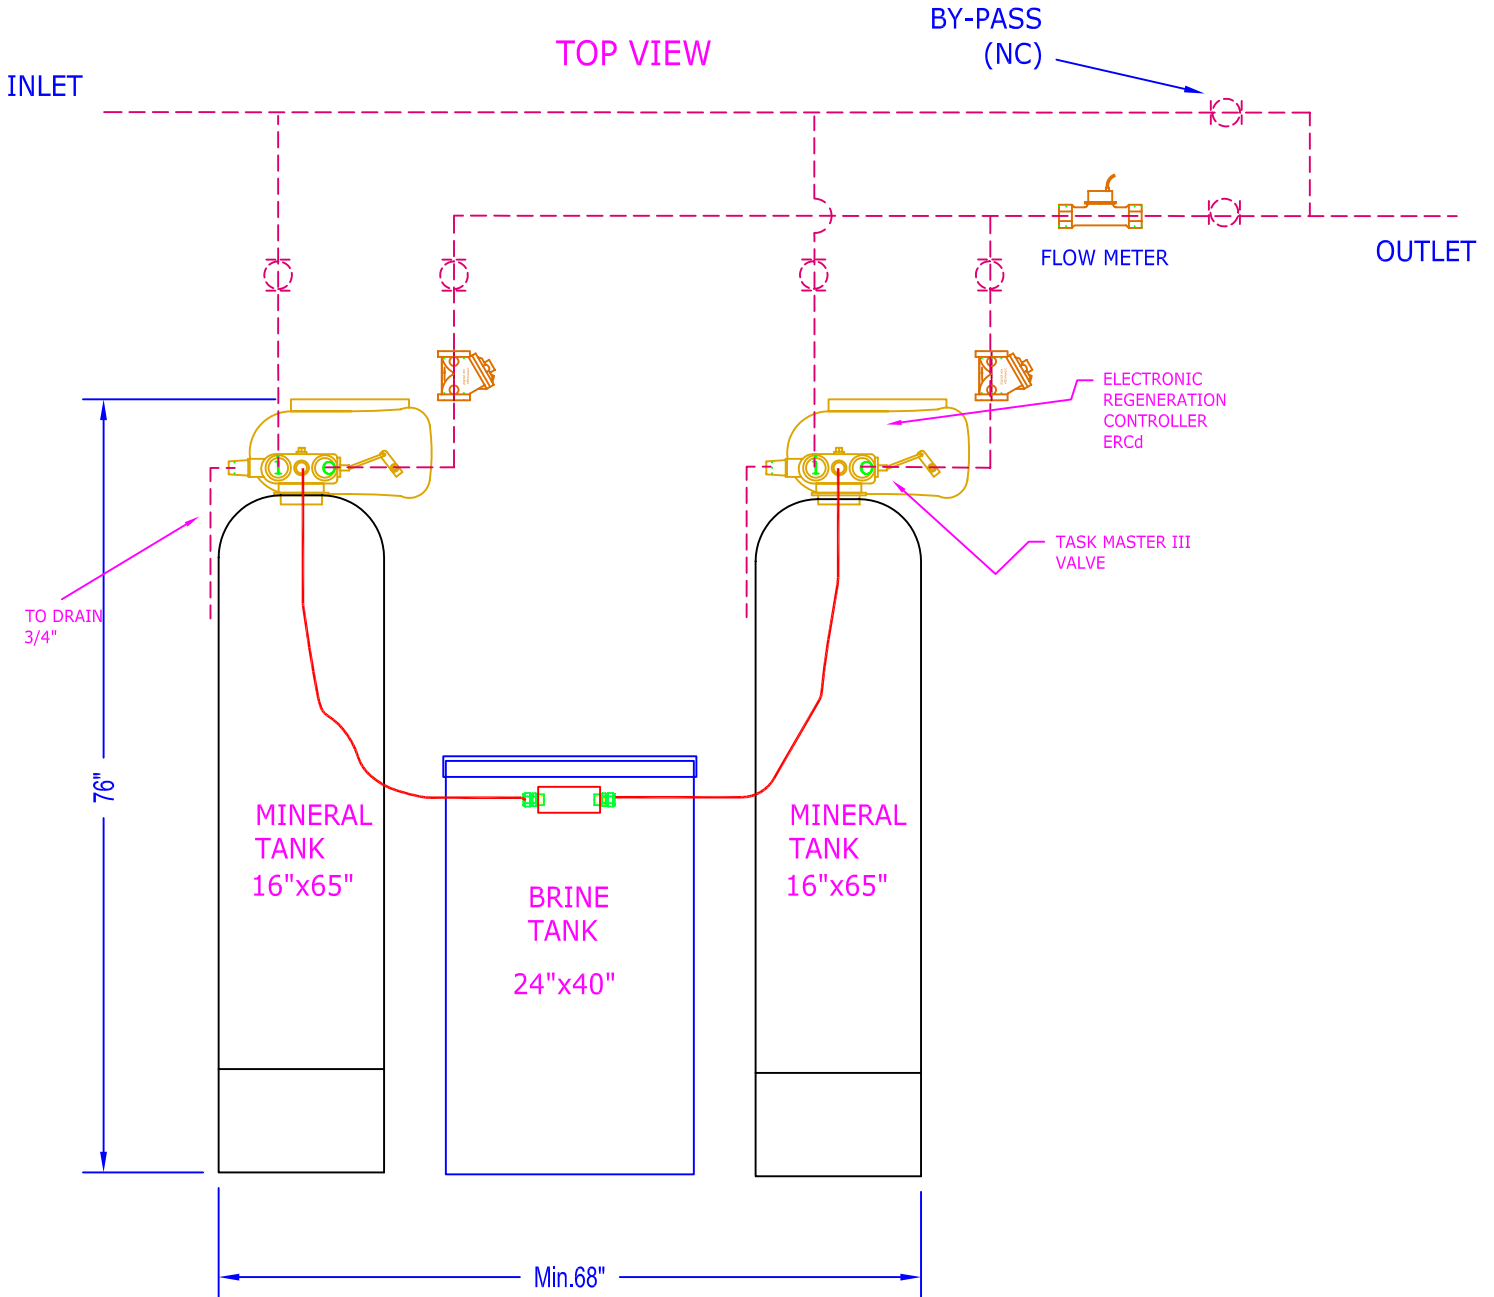

FRONT VIEW

NOTES:

- 1) PIPING SHOWN IN DASHED LINES - SUPPLIED BY CUSTOMER
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING
- 3) FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION
- 4) FLOW METER SHOULD BE MOUNTED HORIZONTALLY

J:\Drawings\catalog\RF\WKRF120T.dwg, 3/14/2011 4:06:35 PM, RaymondRichardson, Adobe PDF, Letter, 1:118.5722, Water King Inc.

BY:	No.	REVISION	DATE	ckd
	0	PRELIMINARY	10/01/99	
	1	UPDATE BRINE TANK	2/22/07	
	2	UPDATE CONTROL VALVE	09/25/07	
	3	UPDATE BRINE TANK	3/17/2009	
	4	ADD TOP VIEW	03/14/2011	



910122-11		
RF-120 TWIN ALTERNATING SOFTENER TYPICAL PIPING ARRANGEMENT		
SCALE @ 24"x36"	DRAWING NUMBER	SHEET
N.T.S.	WKRF120T	01 / 0 1
www.waterking.com		

SHIPPING NO.	845 INC.
OPERATING NO.	

102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529 Telephone: (337) 988-2360 * Fax: (337) 981-7922