


TOP VIEW

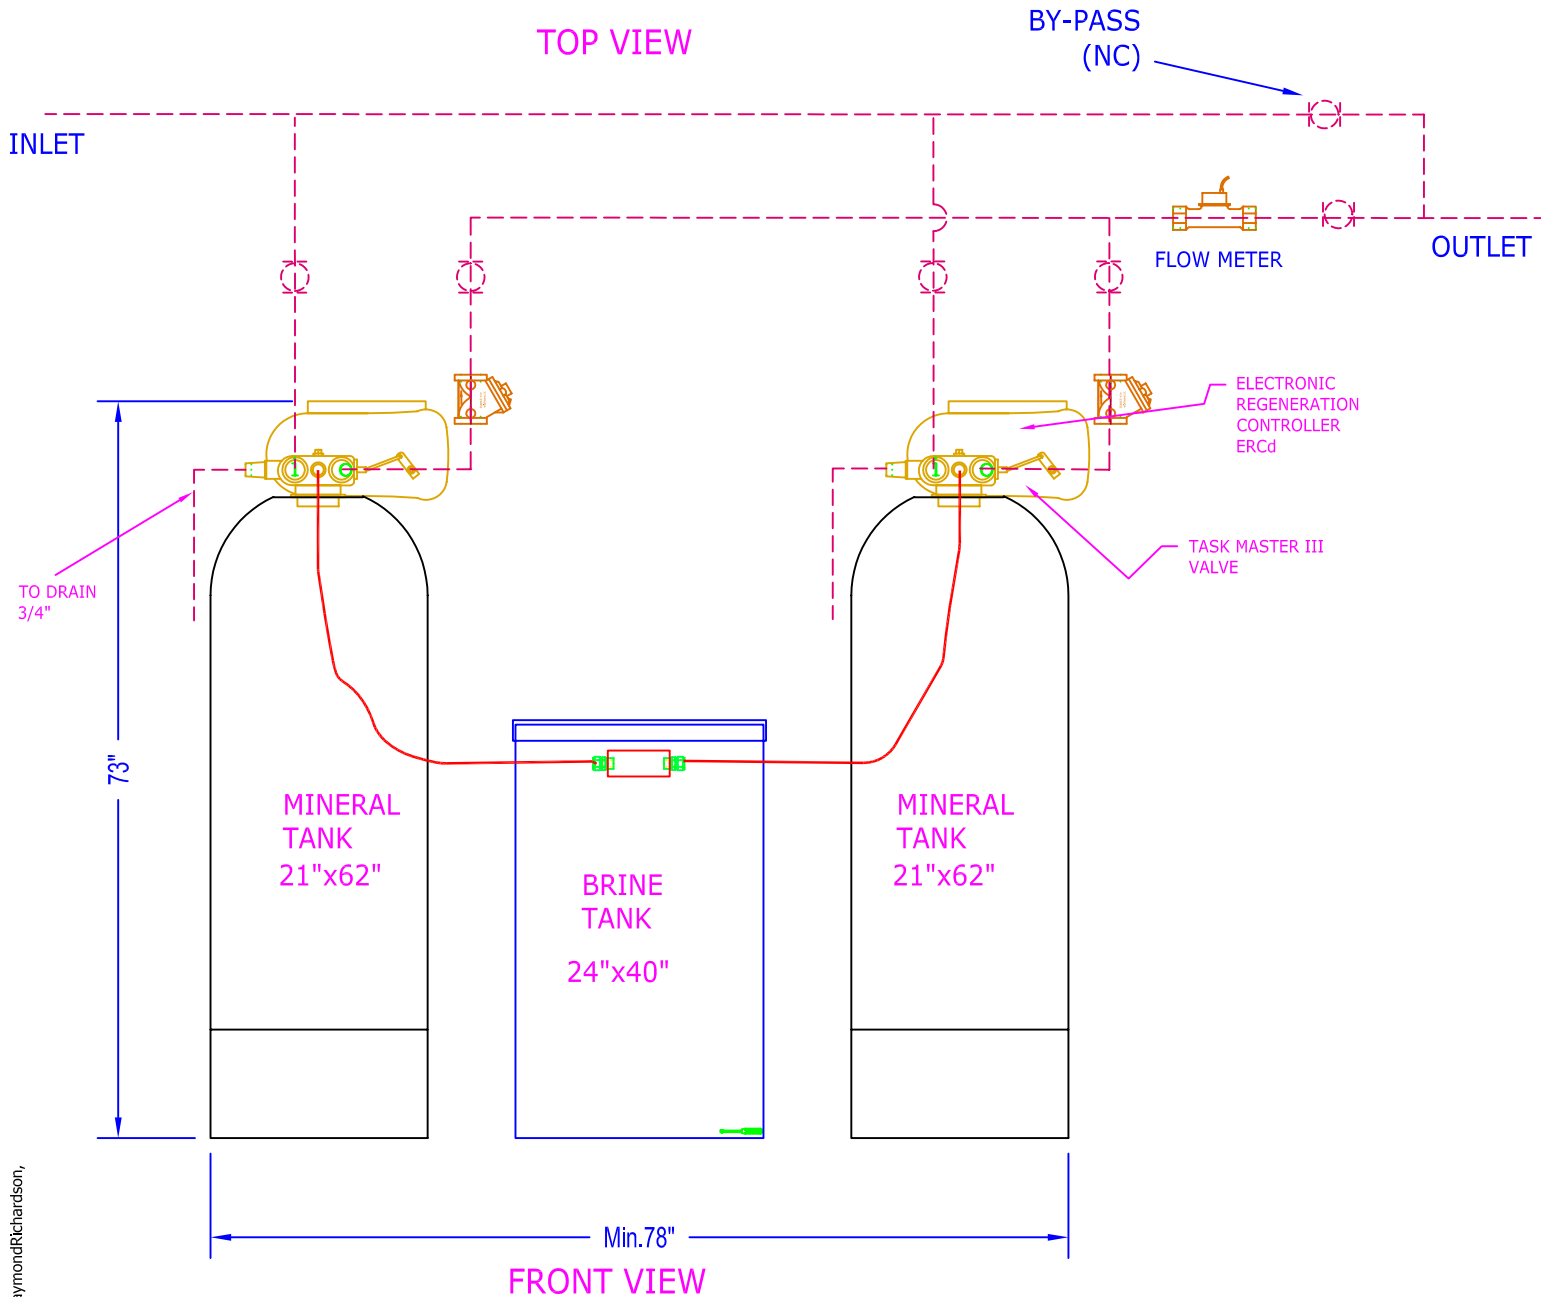

FRONT VIEW

NOTES:

- 1) PIPING SHOWN IN DASHED LINES - SUPPLIED BY CUSTOMER
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING
- 3) FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION
- 4) FLOW METER SHOULD BE MOUNTED HORIZONTALLY

C:\CATALOG\Wkrf150T.dwg, 3/15/2011 9:09:07 AM, RaymondRichardson, Adobe PDF, Letter, 1:18.5722, Water King Inc.

SHIPPING Wt.	335 Lbs.
OPERATING Wt.	

BY:	No.	REVISION	DATE	CKD
	0	PRELIMINARY	10/01/99	
	1	UP-DATE CONTROL VALVE	9/25/2007	
	2	ADD TOP VIEW	03/15/2011	



910152-11
RF-150 TWIN ALTERNATING
TYPICAL PIPING ARRANGEMENT

SCALE @ 24"x36"	DRAWING NUMBER	SHEET
N.T.S.	WKRF150T	01 / 0 1
www.waterking.com		

102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529

Telephone: (337) 988-2360 * Fax: (337) 981-7922