


BY-PASS
(NC)

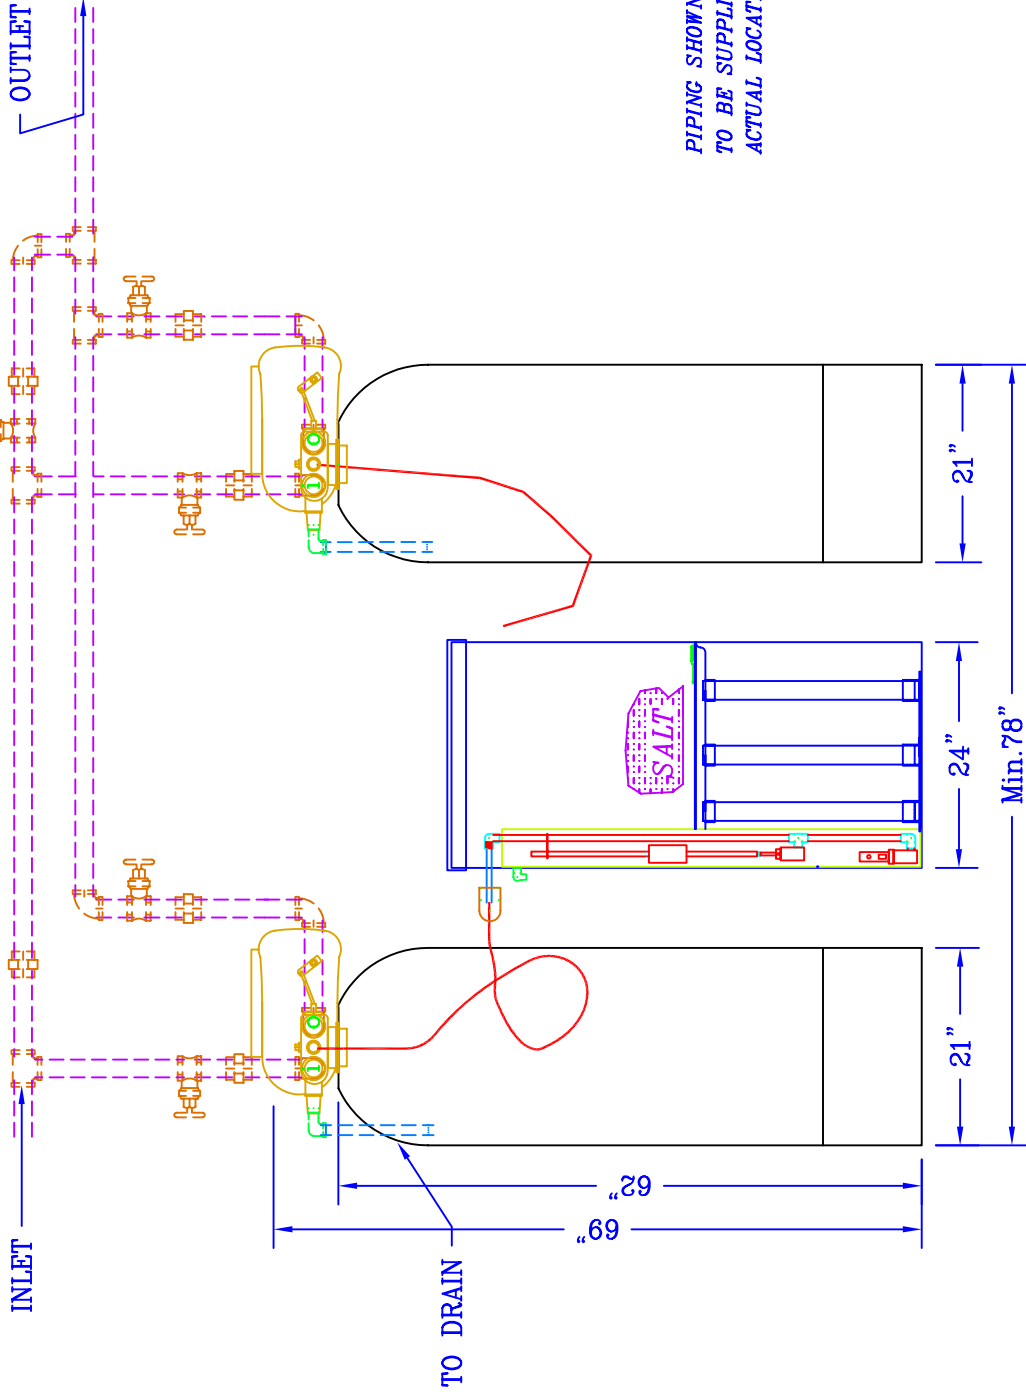

PIPING SHOWN IN DASHED LINES IS
TO BE SUPPLIED BY CUSTOMER
ACTUAL LOCATION & LENGTH MAY VARY

BY#	NO.	REVISION	DATE	ICD
0		PRELIMINARY	10/01/09	
1		IN-GATE CONTROL VALVE	9/25/2007	
2		IN-GATE BRINE VALVE	03/17/2009	

Water King
WATER CONDITIONING

910152	
RF-150 TWIN PARALLEL	
TYPICAL PIPING ARRANGEMENT	
SCALE @ 24"x36"	SHEET
N.T.S.	WKRFL50T
	01 / 0 1
www.waterking.com	

Telephone: (337) 988-2500 * Fax: (337) 981-7922

102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529