


TOP VIEW

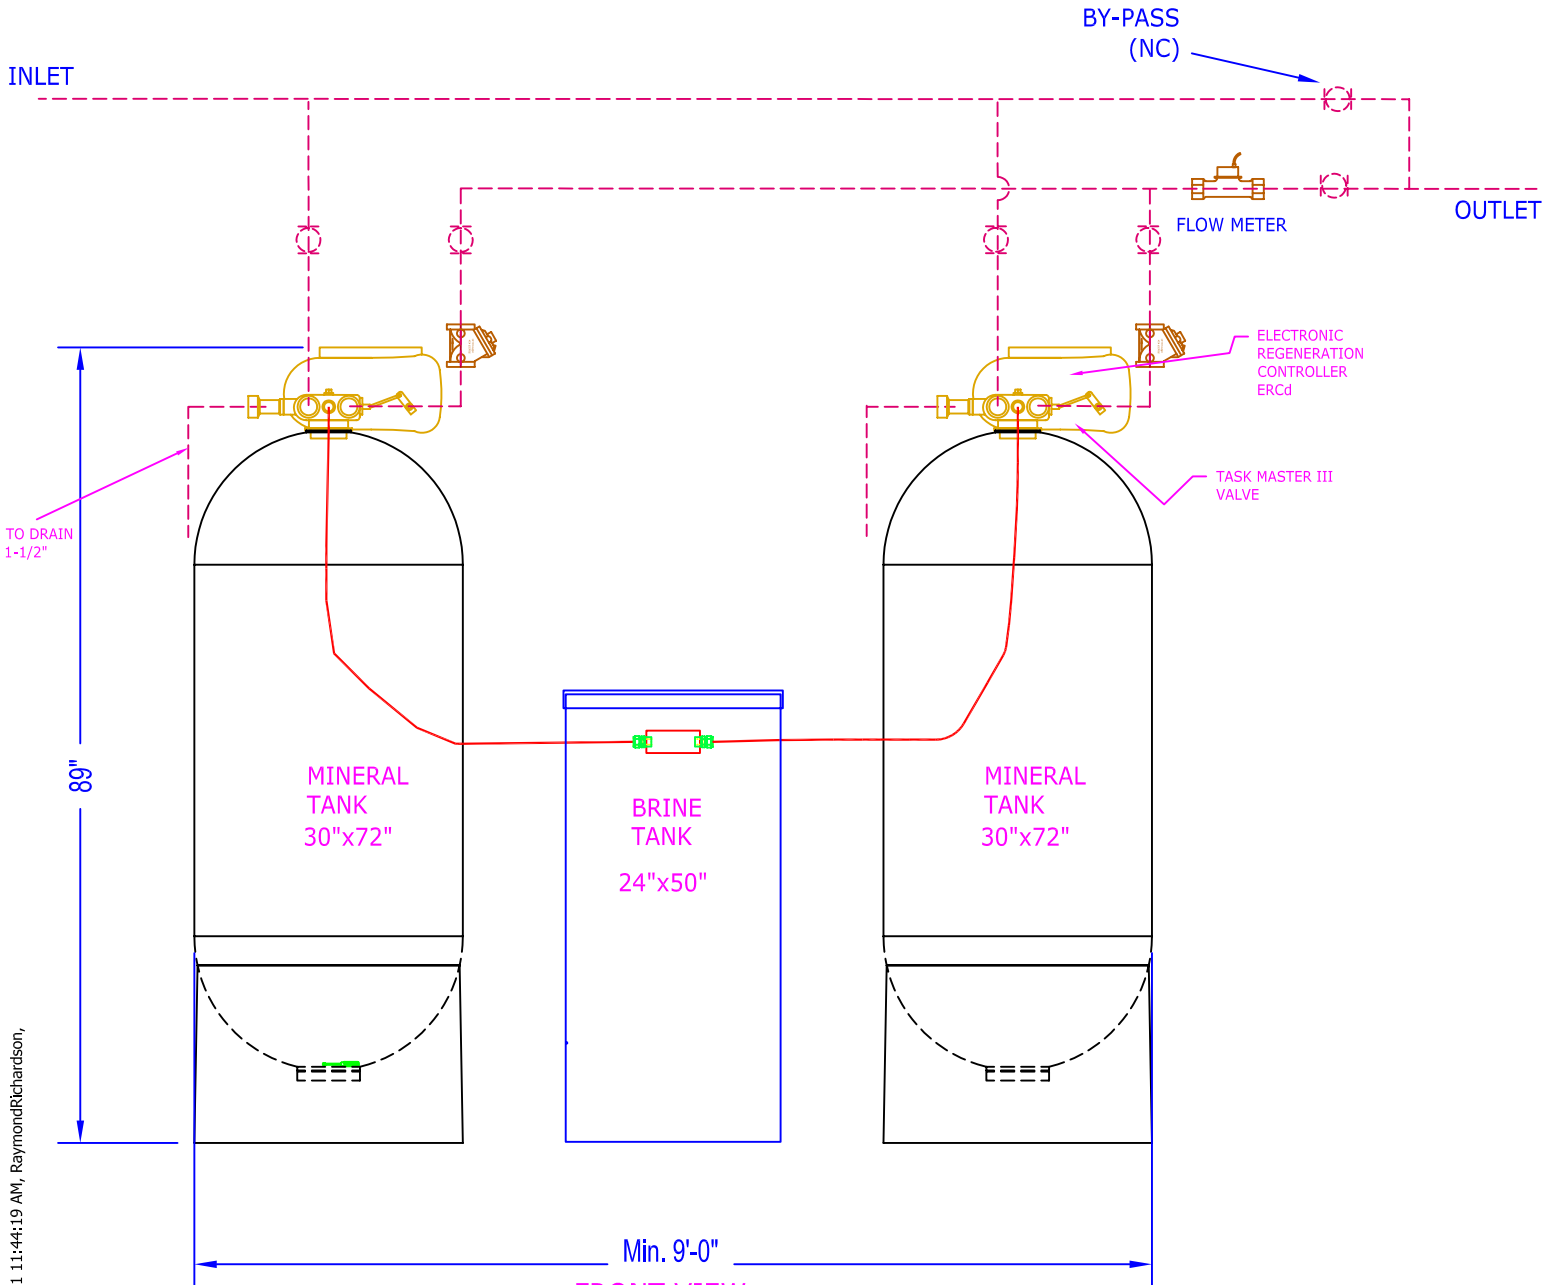

FRONT VIEW

NOTES:

- 1) PIPING SHOWN IN DASHED LINES - SUPPLIED BY CUSTOMER
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING
- 3) FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION
- 4) FLOW METER SHOULD BE MOUNTED HORIZONTALLY

J:\Drawings\catalog\RF\WKRF300T.dwg, 3/15/2011 11:44:19 AM, RaymondRichardson, Adobe PDF, Letter, 1:21,4509, Water King Inc.

SHIPPING WT.	2525 lbs.
OPERATING WT.	

BY:	No.	REVISION	DATE	ck'd
.	0	PRELIMINARY	07/13/06	.
.	1	UP-DATE BRINE TANK	03/17/2009	.
.	.			.
.	.			.
.	.			.

102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529



910302-11		
RF-300 TWIN ALTERNATING SOFTENER TYPICAL PIPING ARRANGEMENT		
SCALE @ 24"x36"	DRAWING NUMBER	SHEET
N.T.S.	WKRF300T	01 / 0 1
www.waterking.com		

Telephone: (337) 988-2360 \* Fax: (337) 981-7922