


NOTE:
 PIPING SHOWN IN DASHED LINES IS TO BE SUPPLIED BY CUSTOMER. LOCAL LOCATION & LENGTH MAY VARY.
 FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION.
 METER SHOULD BE MOUNTED HORIZONTALLY.

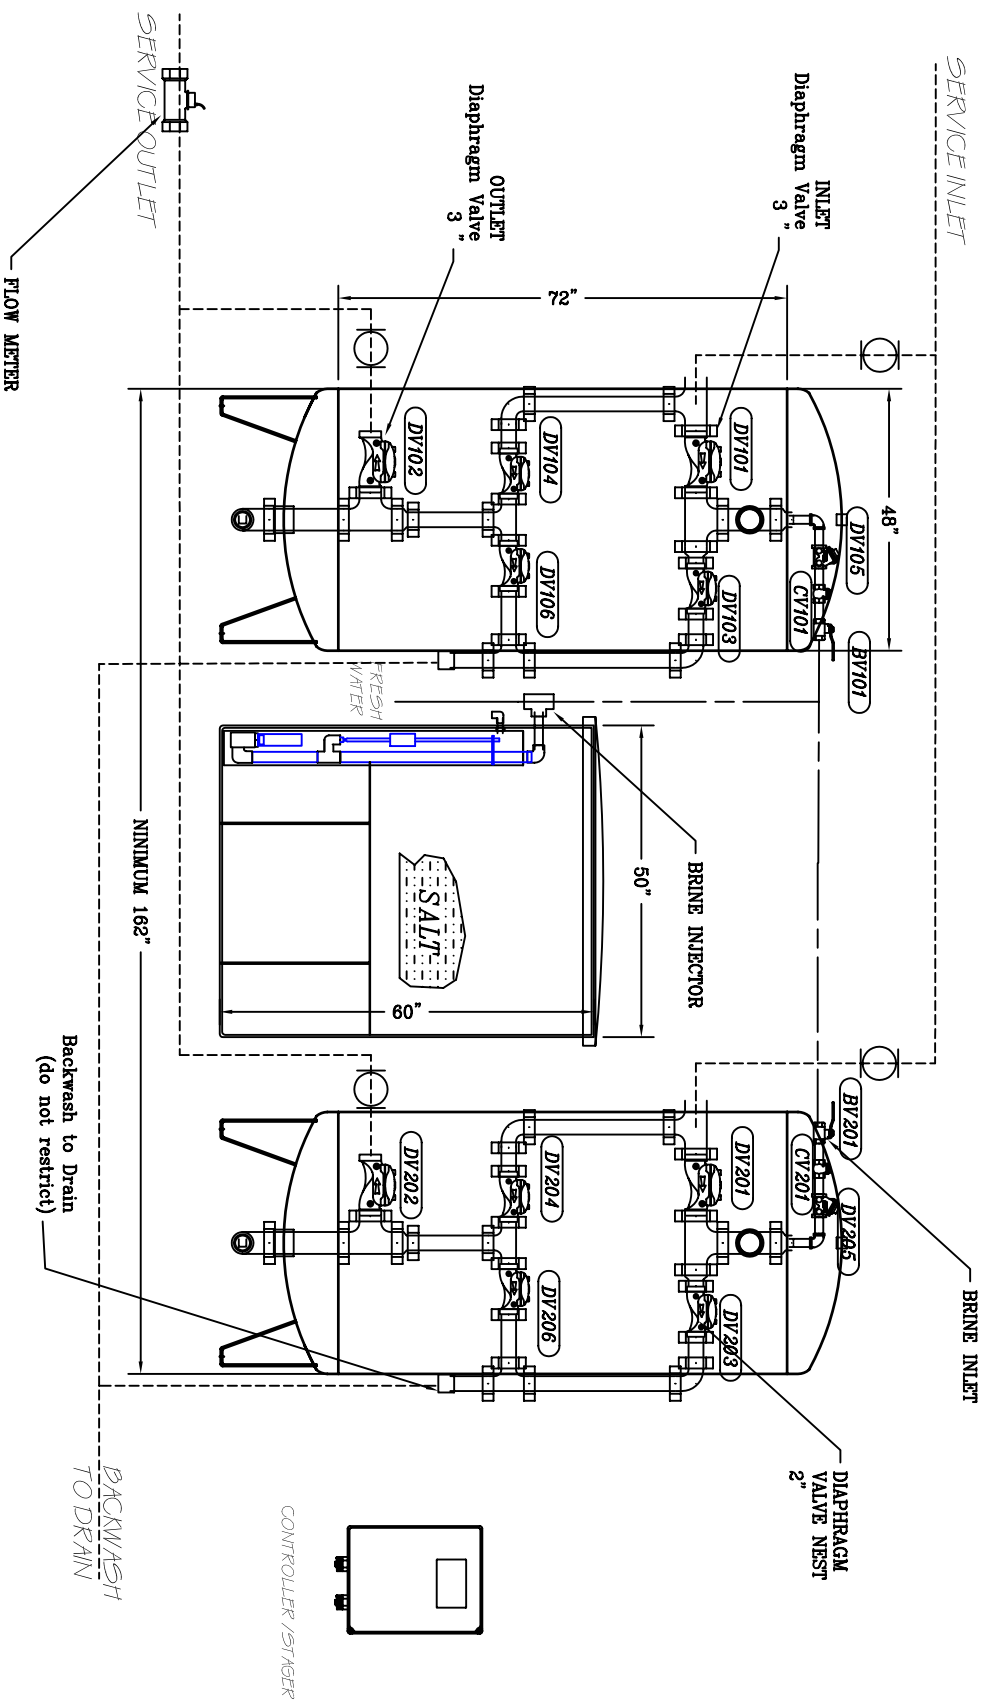

BV#	NO.	REVISION	DATE	BY
1	1	REVISION	11/06/08	
2	1			
3	1			
4	1			
5	1			
6	1			
7	1			
8	1			
9	1			
10	1			

102 Charbonnet Rd., Duson, Louisiana, U.S.A. 70529 Telephone: (337) 988-2360 • Fax: (337) 981-7922

Water King
 WATER CONDITIONING

WATER KING
 VN-1200-3-TA SOFTENER
 TYPICAL PIPING ARRANGEMENT

SCALE: 3/4"=1'-0"
 N.T.S.

DRAWING NUMBER: WKVN-1200-3-TA
 SHEET: 01 / 01
 WWW.WATERKING.COM