


NOTE:
 PIPING SHOWN IN DASHED LINES IS
 TO BE SUPPLIED BY CUSTOMER
 ACTUAL LOCATION & LENGTH MAY VARY

FLOW METER REQUIRES (15) PIPE DIAMETER
 LENGTHS BEFORE METER & (10) AFTER FOR
 PROPER OPERATION
 METER SHOULD BE MOUNTED HORIZONTALLY

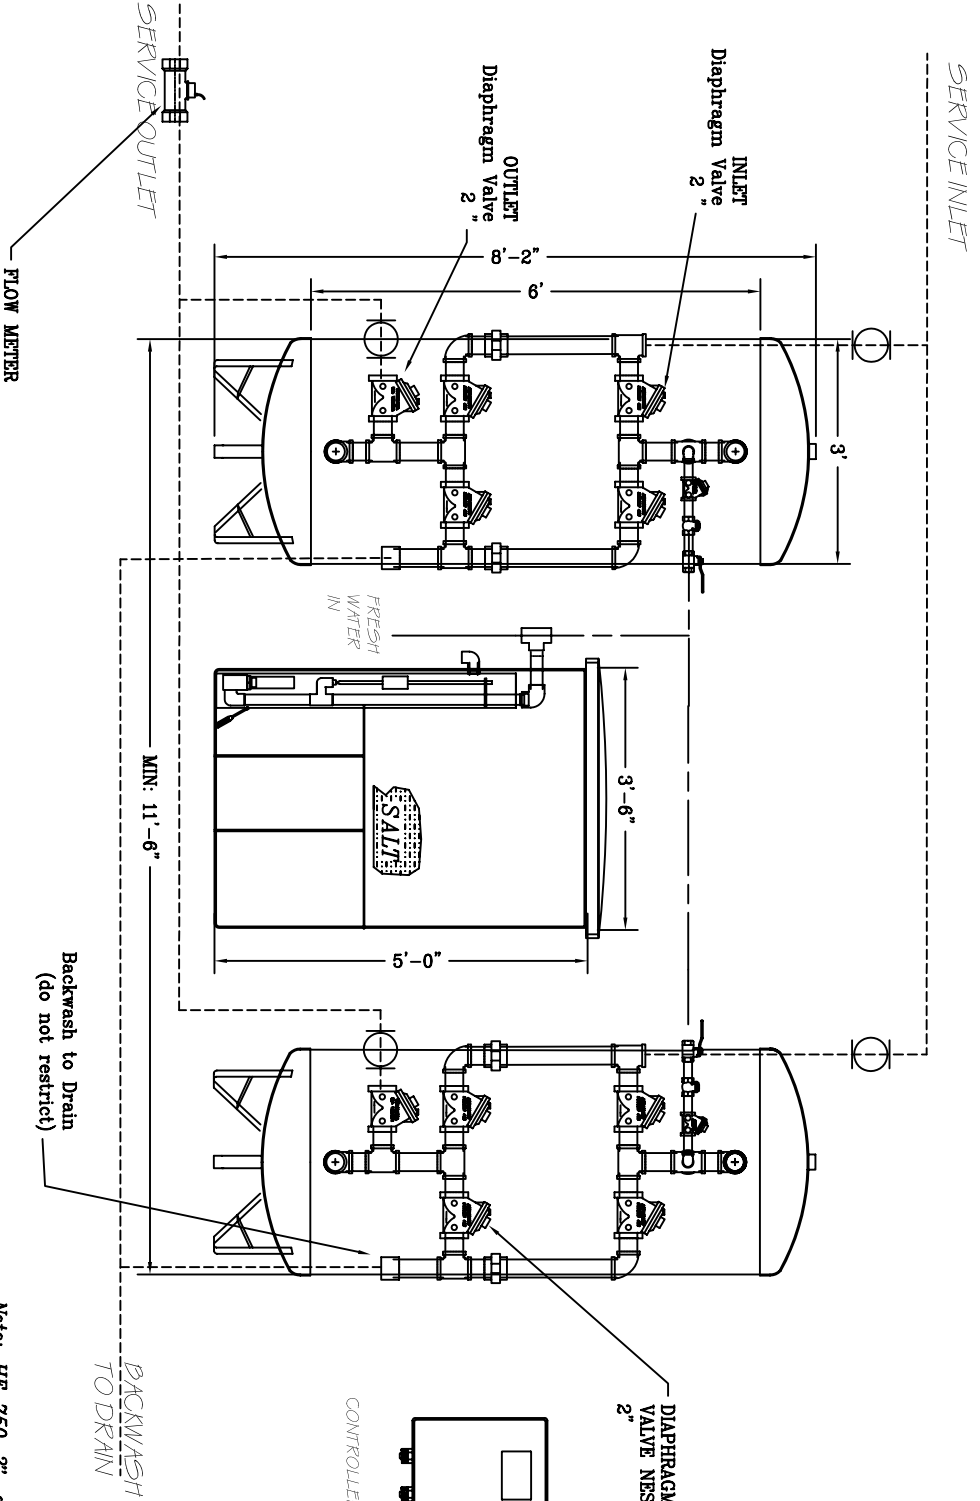

Note: HF-750-2", and HF-750-2 1/2"
 are identical except for pipe size.

REV.	NO.	REVISION	DATE	BY
0	1	PRELIMINARY		

Water King
 WATER CONDITIONING
 Water King, Inc.
 108 Chateaufort Rd., Duoss, Louisiana, U.S.A. 70089
 Telephone: (337) 998-2800 • Fax: (337) 991-7922
 WWW.WATERKING.COM

HP-750-2"-VN-TA	SOFTENER
TYPICAL PIPING ARRANGEMENT (VALVE NEST)	
DATE: 6/15/06	REV.:
SCALE: 3/4"=1'-0"	DESIGN NUMBER: PKRPN750-2-TA
NO. SHEETS: 1	TOTAL SHEETS: 1