


FOR TWIN PARALLEL  
MF 1-1/2" SOFTENERS

- 1) ADD "-12" TO THE PART NUMBER
- 2) ADD PW 150 FLOW METER  
( PART # 500841)
- 3) USE ERCD CONTROLLER  
RATHER THAN SECONDARY
- 4) NOTE INSTALLATION PIPING  
BY OTHERS

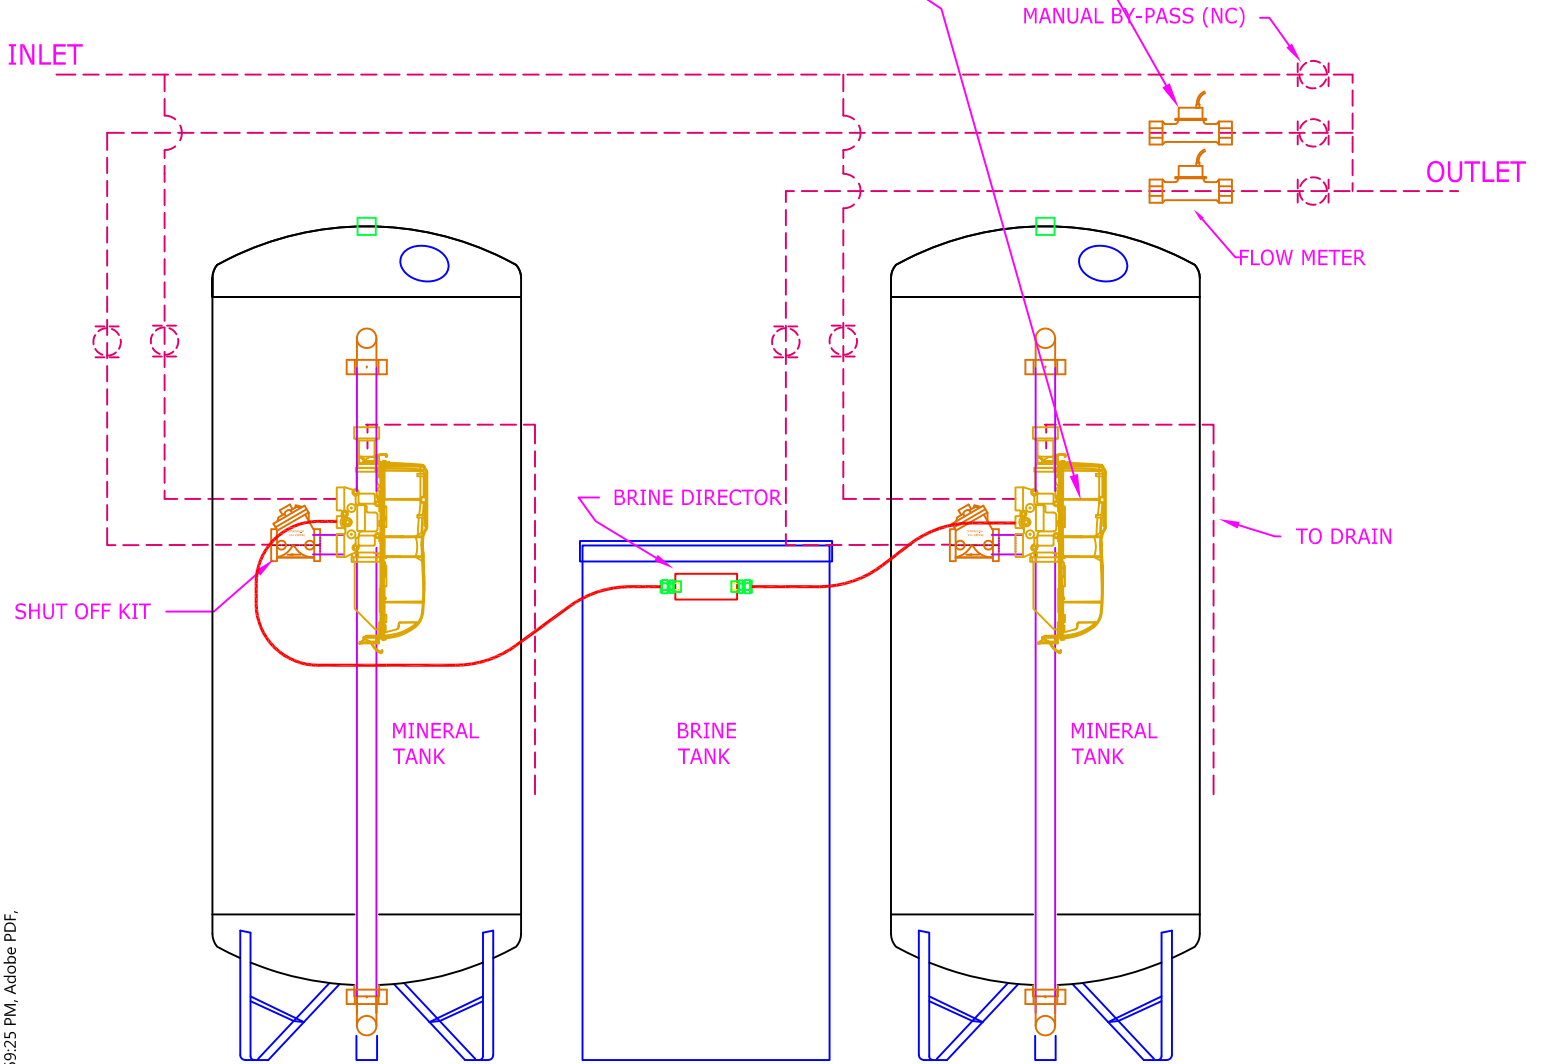

ELEVATION

NOTES:

- 1) PIPING SHOWN IN DASHED LINES TO BE SUPPLIED BY CUSTOMER.
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING.
- 3) FLOW METER REQUIRES (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION.
- 4) FLOW METER SHOULD BE MOUNTED HORIZONTALLY.

BY:	No.	REVISION	DATE	CK'D
RLR	0	SUBMITTAL FOR APPROVAL	05/22/2014	JEB

**Water King**

920XX2-12  
MF-1-1/2" TWIN PARALLEL SOFTENER  
GENERAL ARRANGEMENT

SCALE	DRAWING NUMBER	SHEET
N.T.S.	MF-1.5-TP ADD	01 / 01