


FOR TWIN PARALLEL
 RF / MF SERIES WATER SOFTENERS
 ADD TO RF-TA OR MF-1 1/2"-TA

- 1) ADD "-12" TO THE PART NUMBER
- 2) ADD PW150 FLOW METER
(PART # 500841)
- 3) USE ERCd CONTROLLER
RATHER THAN SECONDARY
- 4) NOTE INSTALLATION PIPING
BY OTHERS

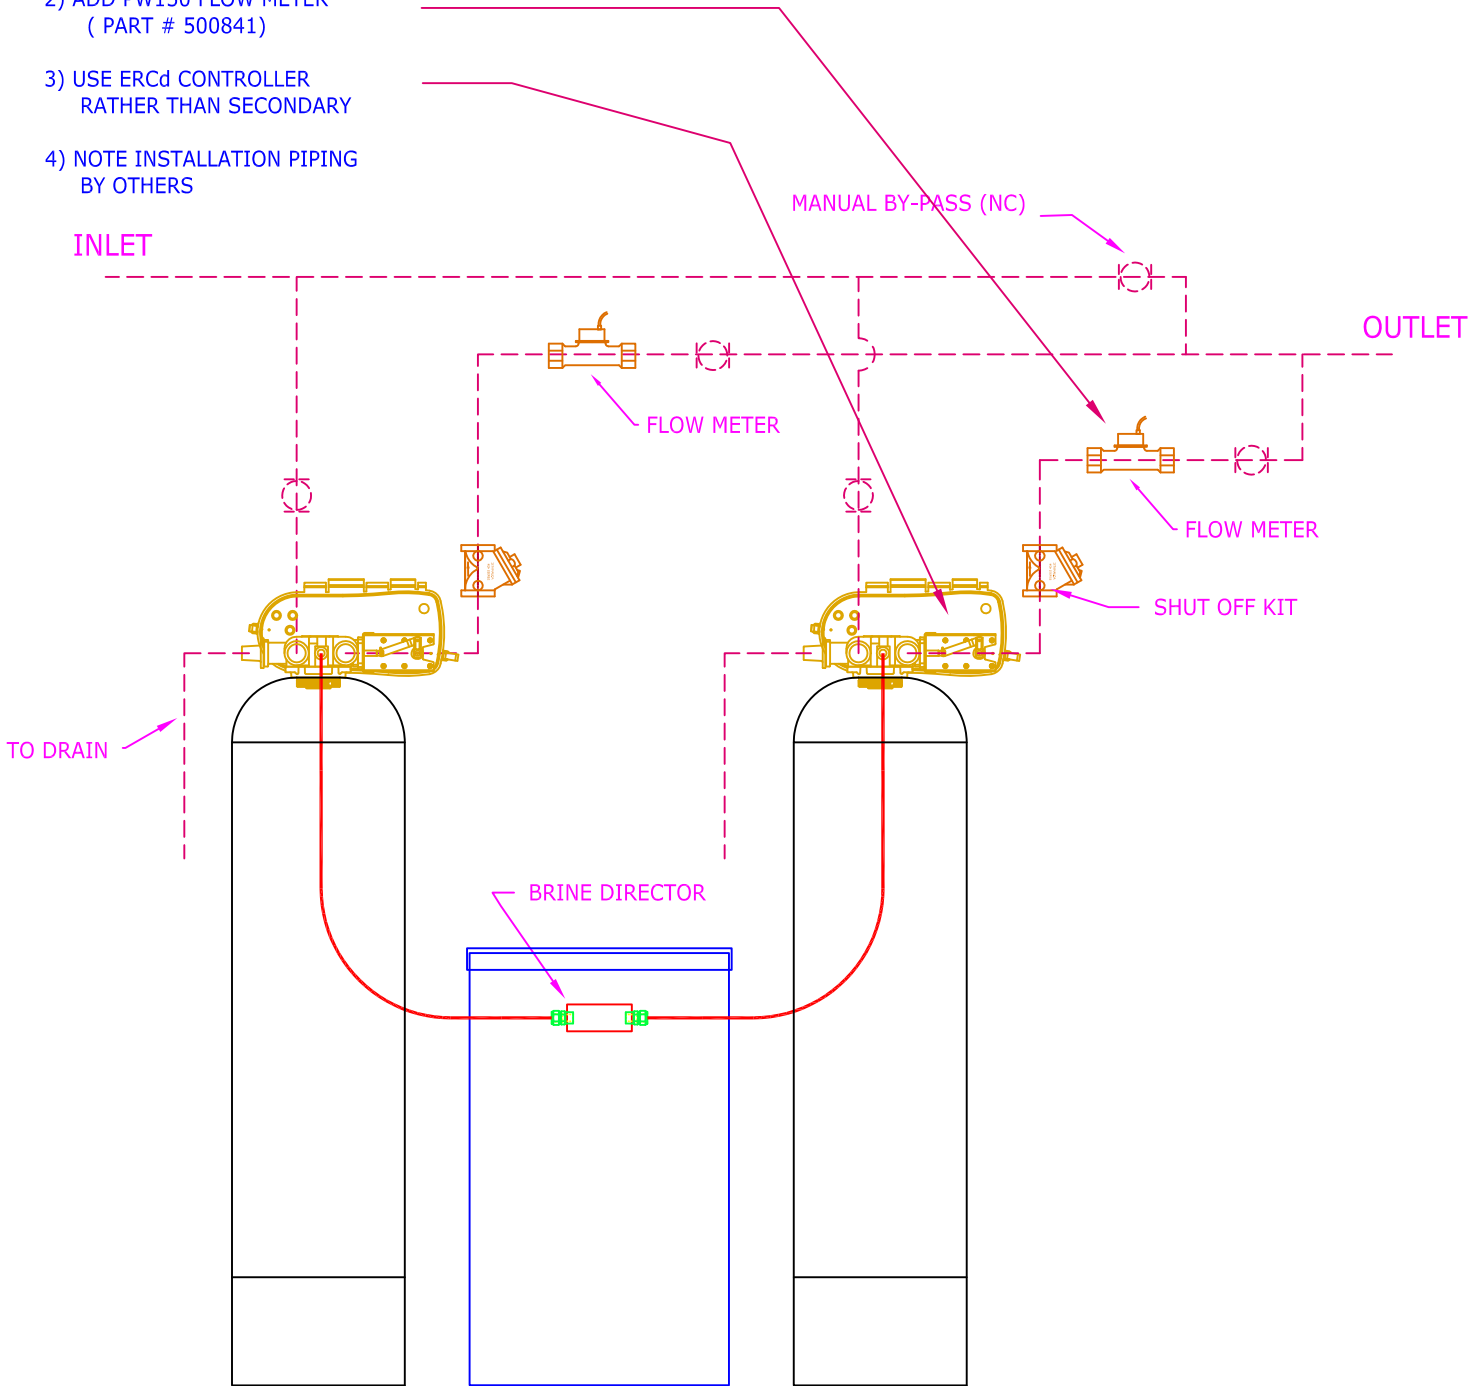

NOTES:

- 1) PIPING SHOWN IN DASHED LINES TO BE SUPPLIED BY CUSTOMER.
- 2) ALLOW 1 FOOT ABOVE TANKS FOR LOADING.
- 3) FLOW METERS REQUIRE (15) PIPE DIAMETER LENGTHS BEFORE METER & (10) AFTER FOR PROPER OPERATION.
- 4) FLOW METERS SHOULD BE MOUNTED HORIZONTALLY.

J:\Drawings\catalog\RF\RF-TP ADD.dwg, 5/22/2014 11:35:30 AM, Adobe PDF, Letter, 1:17/683, WATER KING Inc.

BY:	No.	REVISION	DATE	CK'D
RLR	0	SUBMITTAL FOR APPROVAL	05/16/2014	JEB



910XX2-12 ADD RF-XX-TP TWIN PARALLEL ADDER		
SCALE	DRAWING NUMBER	SHEET
N.T.S.	RF-TP ADD	01 / 01
www.waterking.com		